


IMPORTANT NOTES

- 1 This P&ID is **TYPICAL ONLY** and Only Relates to the Specifications of the Minimum Equipment Required to Ensure the Optimum Performance, Maximum Life and Trouble-Free Operation of the Ebsray R75 Pumpset and the Pumping System in General.
- 2 This P&ID Does **NOT** Depict:
 - 2.1 Ancillary Required Equipment Related to the Fabrication, Installation and Operation of the Pumpset e.g. Misc. Flanges, Fittings, Etc..
 - 2.2 Required Equipment unrelated to the Pumpset e.g. Tank Fill Lines, Vapour Return Lines, Emergency Shutdown Systems, Etc.
 - 2.3 The Materials and Method of Fabrication and/or Installation of the Tank and Required Sub-Systems.
- 3 It is the Responsibility of the Designer, Fabricator and the Installer of Each Actual Tank and Required Sub-Systems to Ensure that:
 - 3.1 The Ebsray Specifications within this P&ID and any other Relevant Ebsray Documents are **STRICTLY** Adhered to.
 - 3.2 Any Variation (Including Use of Equipment Deemed "Equivalent") or Addition to the Ebsray Specifications, as Related to the Pumpset and the Pumping System in General, meet Ebsray's Minimum Requirements.
 - 3.3 All Design, Fabrication and Installation of the Tank and Required Sub-Systems is **STRICTLY** in Accordance with all Relevant Federal, State and Local Codes, Regulations and Standards.
- 4 Ebsray Reserves the Right to:
 - 4.1 Withdraw or Alter Any or All of the Ebsray Specifications within this P&ID and any other Relevant Ebsray Documents without Notification.
 - 4.2 Determine the Validity of Any Warranty Claims for Ebsray Equipment Based on the Proper Application of Ebsray Supplied Equipment by the way of Adherence to the Ebsray Specifications within this P&ID and any other Relevant Ebsray Documents.

BYPASS	REGION
BLACKMER 'BV2A' + EBSRAY 'CBS BV2' KIT	NORTH AMERICA & EUROPE
EBSRAY 'RV19CBS'	ALL OTHER REGIONS

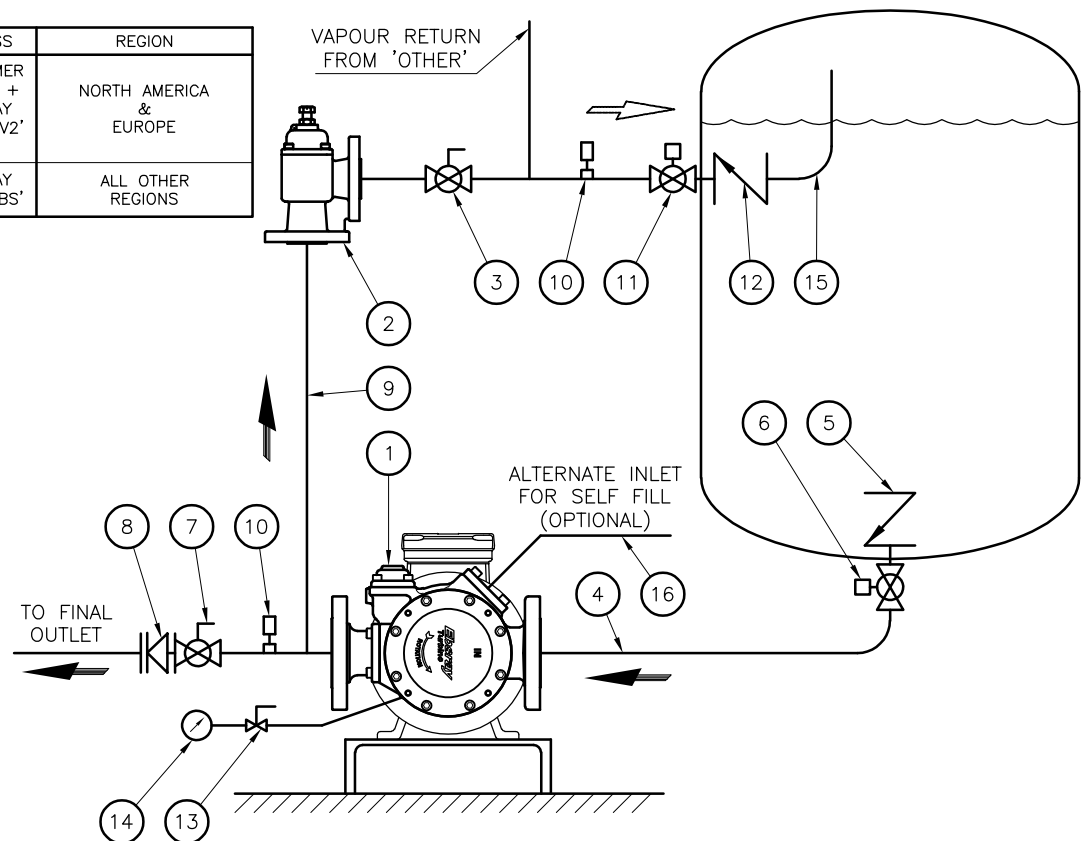

ITEM	DESCRIPTION	SUPPLY	QTY
1	EBSRAY 'R75' & 'R77' PUMPSET DN80 (3") ANSI CLASS 300 INLET, DN50 (2") OR DN80 (3") NPT/ANSI CLASS 300 DISCHARGE AND OPTIONAL ALTERNATE INLET	EBSRAY	1
2	EBSRAY 'RV19VRS' DN40 (1-1/2") ANSI CLASS 300 OR BLACKMER 'BV2A' BYPASS VALVE DN50 (2") NPT + EBSRAY 'CBS BV2' KIT BYPASS VALVE (SEE TABLE FOR REGIONAL VARIANTS)	EBSRAY	1
3	DN40 (1-1/2") MIN. FULL BORE BALL VALVE (FOR SERVICE)	COM'L	1
4	DN80 (3") Sch 40 PIPE (PUMP INLET - IN TANK)	COM'L	1
5	DN80 (3") MIN. LOW PRESSURE DROP EXCESS FLOW VALVE REGO 'A1519A6' OR SIMILAR	COM'L	1
6	DN80 (3") FULL BORE PNEUMATIC ACTUATED BALL VALVE-FIRST CONNECTION	COM'L	1
7	DN50 (2") MIN. FULL BORE BALL VALVE	COM'L	1
8	DN50 MIN. SOFT SEATED BACK CHECK VALVE WITH CATHODIC GASKET/UNION	COM'L	1
9	DN50 (2") Sch 40 PIPE (PUMP DISCHARGE & BYPASS RETURN)	COM'L	1
10	DN8 (1/4") HYDROSTATIC RELIEF VALVE	COM'L	2
11	DN50 (2") MIN. FULL BORE PNEUMATIC ACTUATED BALL VALVE-FIRST CONNECTION	COM'L	1
12	DN50 (2") MIN. EXCESS FLOW VALVE (NOT NON-RETURN VALVE)	COM'L	1
13	DN8 (1/4") ISOLATION VALVE	COM'L	1
14	63mm, 0-2500 kPa (400 PSID) PRESSURE GAUGE	COM'L	1
15	DN50 (2") SPRAY FILL INTO VAPOUR SPACE	COM'L	1
16	DN50 (2") Sch 40 PIPE (PUMP ALTERNATE INLET-SELF FILL-OPTIONAL)	COM'L	1

REV	DATE	DESCRIPTION	REV. BY	CKD. BY	APPR. BY

UNLESS STATED
OTHERWISE
ALL DIMENSIONS IN
MILLIMETRES

Ebsray
part of PSG | a **DOVER** company
ABN 52 000 061 003
156 South Creek Road Ph.(61 2) 9905 0234
Cromer NSW 2099 Fax(61 2) 9938 3825
Australia www.ebsraypumps.com.au

TITLE: TYPICAL INSTALLATION P&ID EBSRAY R75 & R77 PUMP		
SCALE: NA	DATE: 2020-OCT-28	
DRAWN: G.B.T.B.	CHK.D: J.J.D.	APPR.:
COMP.No: A900003K	DRG.No A900003K	REV. A